


THIS DOCUMENT IS THE PROPERTY OF DME INC., AND CANNOT BE DISTRIBUTED WITHOUT DME'S AUTHORIZATION

REVISIONS				
ZONE	REV.	DESCRIPTION	DATE	APPROVED

### BILL OF MATERIAL

ITEM	QTY	DESCRIPTION	MATERIAL
1	2	PIPE, SCH. 40 STEEL PE/BE	A 240 T-321
2	4	BRAID COLLAR,	A 36
3	1	STD. WT. L.R. 90° WELD ELBOW	A 240 T-321
4A	2	METAL CONVOLUTED HOSE	A 240 T-321
4B	2	METAL BRAID	A 240 T-321
5	2	LIFTING LUG	

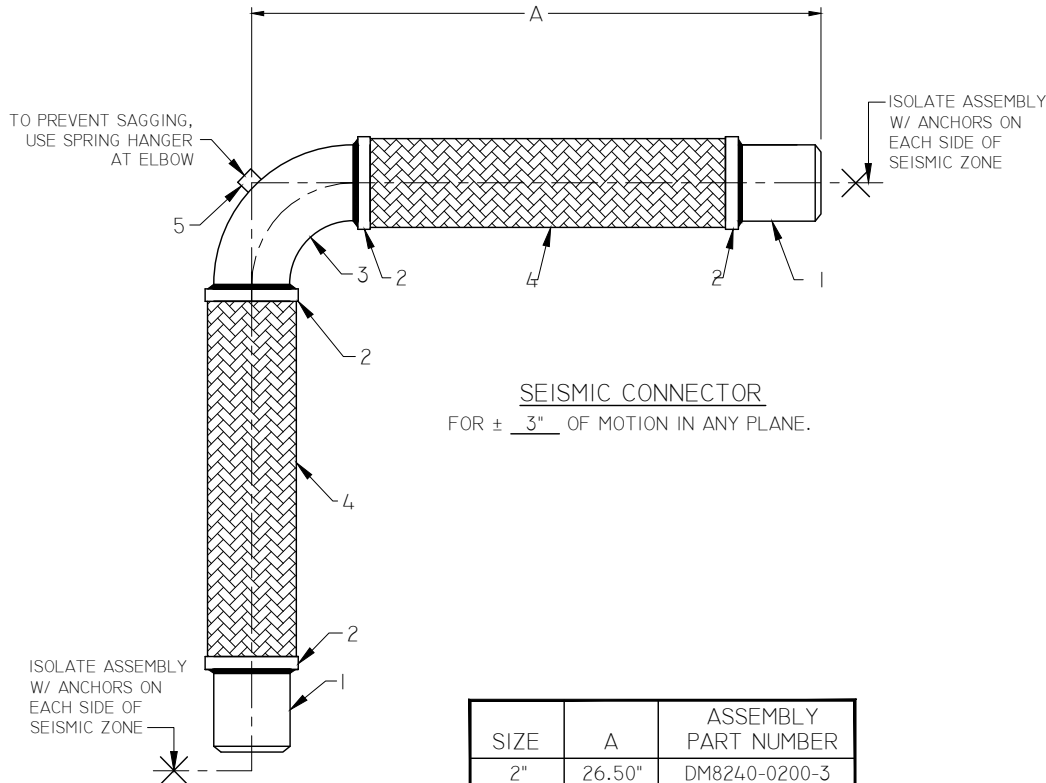

**SEISMIC CONNECTOR**  
FOR ± 3" OF MOTION IN ANY PLANE.

SIZE	A	ASSEMBLY PART NUMBER
2"	26.50"	DM8240-0200-3
2-1/2"	29.00"	DM8240-0250-3
3"	30.50"	DM8240-0300-3
4"	34.25"	DM8240-0400-3
5"	37.25"	DM8240-0500-3
6"	41.50"	DM8240-0600-3
8"	52.00"	DM8240-0800-3
10"	56.00"	DM8240-1000-3
12"	60.00"	DM8240-1200-3

**GENERAL NOTES:**

- A. ALL WELDING T.I.G. (HELI-ARC) IN ACCORDANCE WITH ASME SECTION IX.
- B. PRESSURE TEST ALL ASSEMBLIES AIR UNDER WATER AFTER FABRICATION, NO LEAKAGE.
- C. AFTER A SEISMIC OCCURENCE, THE SEISMIC EXPANSION JOINTS AND FLEX CONNECTORS MUST BE INSPECTED FOR DAMAGE AND REPLACED IF NECESSARY.
- D. SIZES 8" - 12" PROVIDED WITH LIFTING LUG.

APPROVED BY:.....

DATE:..... PO#:.....

ALL DIMENSIONS ARE IN INCHES



**DME INC.**  
14001 MARQUARDT AVE.  
SANTA FE SPRINGS, CA  
90670  
TEL: 562-921-0464  
FAX: 562-802-7489

\*\*\*\*\*  
ANY CHANGES ON THE  
DRAWING MUST BE  
REPORTED AND APPROVED  
ONLY BY  
THE ENGINEERING DEPARTMENT  
\*\*\*\*\*

CUST: JOB#			<b>SEISMIC CONNECTOR W/ PIPE WELD ENDS</b>			UNLESS OTHERWISE SPECIFIED TOLERANCES ARE :		
DESIGN: PER CUST.	01-30-2013	SIZE	DM8240-3	DWG NO.	REV.	.XXX ± .010"	FRACTIONS: ± 1/8"	
APPROVED BY: E.F.	01-30-2013	SCALE	DM8240-3	DATE:	SHT	.XX ± .030"	EXP. JOINTS:	
DWG: M.N.	01-30-2013	NONE	DM8240-3	01-30-2013	1 OF 1	.X ± .060"	OAL: ± 1/8"	
						ANGLES ± 1/2°		